

## Specification Guide

# MX Series

## Indoor Modular Blowers

*Electric Heat, Hot Water Heat, or No Heat*



<b>Contents</b>	<b>Page</b>
Standard Features .....	2
Physical Data .....	2
Blower Performance.....	3
Nomenclature.....	3
Electrical Data.....	4
Water Heating Capacity .....	5
Sample Hydronic Design.....	6
Maximum Line Lengths .....	7
Dimensions .....	8

### **! WARNING !**

To install the MX Series air handler in the horizontal position a (1") clearance must be maintained between the apex of the evaporator coil and the top of the coil's cabinet. Therefore, the ADP multi-position evaporator coils below cannot be used in horizontal applications with the MX Series air handler.

Slab numbers A07, A15, E27, E37, E48, E50, and E55.  
Slab numbers E25 and E35 in 21.5"h cabinet, and slab number E54 in 29.5"h cabinet.



Product improvement is a continuous process at Advanced Distributor Products. Therefore, product specifications are subject to change without notice and without obligation on our part. Please contact your ADP representative or distributor to verify details.

© by Advanced Distributor Products. All rights reserved.

## Standard Features All Models

- Easy Installation: "One-Man-Job"
- Cabinet lined with high quality 5/8" foil faced insulation.
- Available from factory as upflow, downflow, and horizontal.
- Only four screws to remove blower panel, making it easier to service.
- Embossed cabinet in heavy gauge galvanized steel to prevent corrosion.
- Factory installed fan time delay postpones blower shutoff 30 seconds in heating mode and 45 seconds in cooling mode.
- Electrical connections can be made on top or right side for 8,12,& 16 size models and top or left side for 20 size models.
- Dynamically balanced 3-speed PSC motor with easy to adjust settings for fine tuning customer comfort.
- Approved for installation in manufactured housing and mobile homes.

## Standard Features with Electric Heat

- Slide-out panel with one-point electrical connections.
- Electric heat kits with plug in connections available for field installation.

## Standard Features with Hot Water Heat

- Suitable for potable water systems.
- Enhanced grommets - secure & tight.
- Easy to replace hot water coil. Remove one screw and slide out.
- Optional factory installed circulating pump fully encased in cabinet.
- Purge valve on hot water coil allows for manual release of any air trapped in coil during installation or servicing.
- Water connections 7/8" ODF (for 3/4" water pipe) on 08 & 12 models and 1 1/8" ODF (for 1" water pipe) on 16 & 20 models.
- Multi-function control board comes standard factory installed and includes the following features:

Features are compatible with both factory and field installed circulating pumps.

1. Pump timer- Activates pump for 1 minute every 6 hours eliminating stagnant water in hot water coil.
2. 24 VAC isolation valve control-allows for zoning control.
3. Auxiliary contacts for water heater or boiler activation.
4. Freeze protection- standard factory installed, activates at 40 deg. F and deactivates at 70 deg. F.
5. Thermostat connections
6. Time delay for blower activation:
  - 60 seconds (tap in OFF position)
  - 130 deg. F Aquastat (tap in ON position)
  - Note: Aquastat tap only included if ordered

## Physical Data

		Unit Size			
		08	12	16	20
<b>Nominal CFM</b>		800	1,200	1,600	2,000
<b>Available Voltage*</b>		120 V, 60 Hz, 1 ph. or 208/240 V, 60 Hz, 1 ph.			
<b>Maximum Elec. Heat Kit Allowed for Field Installation (kW)</b>		10	15	20	20
<b>Transformer Size &amp; Type</b>		40 VA, Class 2			
<b>Blower Wheel (dia." x width")</b>		9 X 6	10 X 8	10 X 8	10 X 10
<b>Electric Heat Blower Data</b>	<b>Motor H. P.</b>	1/3	1/3	3/4	3/4
	<b>F. L. A. @ 240 V</b>	1.8	2.6	4.4	4.3
<b>Hot Water Heat Blower/Pump Data</b>	<b>Blower Motor H. P.</b>	1/3	1/2	3/4	3/4
	<b>Blower F. L. A. @ 120 V</b>	5.3	7.1	7.5	10.5
	<b>Pump Conn. Size</b>	7/8"			
	<b>Pump Voltage</b>	120 V			
	<b>Pump Amps</b>	.52			
<b>Approximate Weight (lbs)</b>		66	66	71	83

\* Hot water heat only available in 120 V, 60 Hz.

# Blower Performance

## 208/240V Motor

Unit Size	Speed	Airflow (CFM) vs. External Static Pressure (in W.C)				
		0.1	0.2	0.3	0.4	0.5
08	Low	591	601	586	564	513
	<b>*Med</b>	914	881	832	773	699
	High	1077	1020	947	874	768
12	Low	1085	1076	1059	1043	1009
	<b>*Med</b>	1260	1255	1252	1207	1168
	High	1335	1330	1326	1289	1252
16	Low	1512	1487	1444	1399	1315
	Med	1635	1605	1585	1503	1416
	<b>*High</b>	1732	1703	1635	1555	1471
20	Low	1604	1582	1548	1490	1417
	<b>*Med</b>	2064	1993	1907	1817	1709
	High	2218	2131	2039	1943	1829

## 120V Motor

Unit Size	Speed	Airflow (CFM) vs. External Static Pressure (in W.C)				
		0.1	0.2	0.3	0.4	0.5
08	Low	749	705	658	614	558
	<b>*Med</b>	865	815	760	708	646
	High	904	836	801	740	681
12	Low	1198	1144	1086	1018	962
	<b>*Med</b>	1257	1198	1130	1072	1010
	High	1273	1215	1158	1094	1018
16	Low	1576	1514	1433	1338	1264
	Med	1643	1576	1490	1407	1320
	<b>*High</b>	1707	1606	1545	1441	1364
20	Low	1759	1691	1652	1580	1512
	Med	1838	1788	1729	1644	1555
	<b>*High</b>	1928	1867	1810	1729	1637

Speeds marked in **bold with an asterisk\*** are the factory speed settings for both heating and cooling.

All data is given while air handler is operating with a dry DX coil and air filter installed.

These are nominal values and blower performance can vary higher or lower from these values based on the evaporator coil that is used.

Hot water heat airflow performance data includes associated air pressure drop across a 4 row hot water coil for Unit Size 08, 12, & 16; air pressure drop across a 3 row hot water coil for Unit Size 20.

## Nomenclature

MX C 08 00 N 2 E	
<p><b>Series</b> MX Series</p>	<p><b>Heat Size</b>  <b>B</b> = 3 row hot water coil <sup>[1]</sup>                      (available on 08 and 20 models)  <b>C</b> = 4 row hot water coil <sup>[1]</sup>                      (available on 08, 12, and 16 models)  <b>E</b> = No heat (electric heat kits sold separately) <sup>[2]</sup></p>
<p><b>Blower Motor</b> C = 3-speed PSC motor</p>	<p><b>Voltage</b>  <b>2</b> = 208/240 V, 60 Hz, 1 ph., with time delay <sup>[2]</sup>  <b>4</b> = 120 V, 60 Hz, 1 ph., with time delay <sup>[1]</sup></p>
<p><b>Size / Airflow</b>  <b>08</b> = 800 CFM  <b>12</b> = 1200 CFM  <b>16</b> = 1600 CFM  <b>20</b> = 2000 CFM</p>	<p><b>Line Voltage Connection</b> N = Stripped wires</p>
<p><b>Hot Water Coil</b>  <b>00</b> = No hot water coil  <b>WP</b> = Hot water coil with pump  <b>WN</b> = Hot water coil without pump  <b>AP</b> = Hot water coil                      with 130°F aquastat &amp; pump  <b>AN</b> = Hot water coil                      with 130°F aquastat &amp; without pump</p>	<p>[1] Hot water heat only available in 120 V, 60 Hz.                      [2] Electric heat kits can only be used with 208/240 V and are field installed. For these kits, please see accessories price list.</p>

Approved in state of Massachusetts

# Electrical Data

208/240 V, 60 Hz, 1 phase

Unit Size	Elec. Heating Cap. (1)		Blower Amps	Minimum Circuit Ampacity	Circuit Breaker	
	kW	BTUH			Amps Per Stage	
	240 V	240 V			1	2
<b>08 (No Heat)</b>	0	0	1.8	2.3	15	-
<b>08</b>	5	17,065	1.8	28.3	30	-
<b>08</b>	7.5	25,598	1.8	41.3	45	-
<b>08</b>	10	34,130	1.8	54.3	60	-
<b>12 (No Heat)</b>	0	0	2.6	3.3	15	-
<b>12</b>	5	17,065	2.6	29.3	30	-
<b>12</b>	7.5	25,598	2.6	42.3	45	-
<b>12</b>	10	34,130	2.6	55.3	60	-
<b>12</b>	<b>15</b>	51,195	2.6	81.4	60	30
<b>16 (No Heat)</b>	0	0	4.4	5.5	15	-
<b>16</b>	7.5	25,598	4.4	44.6	45	-
<b>16</b>	10	34,130	4.4	57.6	60	-
<b>16</b>	<b>15</b>	51,195	4.4	83.6	60	30
<b>16</b>	<b>20</b>	68,260	4.4	109.7	60	60
<b>20 (No Heat)</b>	0	0	4.3	5.4	15	-
<b>20</b>	7.5	25,598	4.3	44.4	45	-
<b>20</b>	10	34,130	4.3	57.5	60	-
<b>20</b>	<b>15</b>	51,195	4.3	83.5	60	30
<b>20</b>	<b>20</b>	68,260	4.3	109.5	60	60

kW packages in **bold italics** indicate that these heat packages require and include circuit breakers; circuit breakers are optional for all other models.

(1) For 208 Volts use .751 correction factor for kW & BTUH.

# Water Heating Capacity (BTUH)

## Unit Size 08

Water Coil Size	Entering Water Temp	2 GPM			3 GPM			4 GPM		
		H <sub>2</sub> O P.D. (in FT)	CFM		H <sub>2</sub> O P.D. (in FT)	CFM		H <sub>2</sub> O P.D. (in FT)	CFM	
			600	800		600	800		600	800
3 ROW	120°F	0.9	17,800	20,200	1.9	19,600	22,700	3.4	20,800	24,600
	140°F	0.9	25,200	28,500	1.9	27,700	32,000	3.4	29,300	34,700
	160°F	0.9	32,600	37,000	1.8	35,800	41,400	3.3	37,900	44,900
	180°F	0.9	40,100	45,500	1.8	44,000	50,900	3.3	46,500	55,100

Water Coil Size	Entering Water Temp	2 GPM				3 GPM				4 GPM			
		H <sub>2</sub> O P.D. (in FT)	CFM			H <sub>2</sub> O P.D. (in FT)	CFM			H <sub>2</sub> O P.D. (in FT)	CFM		
			650	750	800		650	750	800		650	750	800
4 ROW	120°F	1.6	23,200	25,900	27,600	3.3	25,300	28,400	30,200	5.5	26,700	31,600	33,700
	140°F	1.5	32,300	29,200	31,100	3.2	37,200	37,300	39,700	5.4	39,300	38,100	40,600
	160°F	1.5	39,500	43,300	46,200	3.1	43,100	48,700	51,900	5.2	45,000	51,600	55,100
	180°F	1.4	48,400	53,100	56,700	3.0	52,900	59,700	63,700	5.0	55,100	63,300	67,500

## Unit Size 12

Water Coil Size	Entering Water Temp	3 GPM				4 GPM				5 GPM			
		H <sub>2</sub> O P.D. (in FT)	CFM			H <sub>2</sub> O P.D. (in FT)	CFM			H <sub>2</sub> O P.D. (in FT)	CFM		
			1000	1100	1200		1000	1100	1200		1000	1100	1200
4 ROW	120°F	3.3	33,500	35,000	36,300	5.5	36,200	38,100	39,800	6.9	37,900	40,100	42,000
	140°F	3.2	47,200	49,400	51,300	5.4	51,000	53,700	56,100	6.8	53,500	56,500	59,200
	160°F	3.1	61,100	63,900	66,400	5.2	66,000	69,400	72,500	6.5	69,100	73,000	76,600
	180°F	3.0	75,100	78,600	81,600	5.0	81,000	82,300	89,100	6.3	84,700	89,600	94,000

## Unit Size 16

Water Coil Size	Entering Water Temp	3 GPM				4 GPM				5 GPM			
		H <sub>2</sub> O P.D. (in FT)	CFM			H <sub>2</sub> O P.D. (in FT)	CFM			H <sub>2</sub> O P.D. (in FT)	CFM		
			1400	1500	1600		1400	1500	1600		1400	1500	1600
4 ROW	120°F	1.0	38,600	39,600	40,500	1.7	42,700	44,000	45,200	2.6	45,500	47,000	48,400
	140°F	1.0	54,600	56,000	57,300	1.7	60,300	62,100	63,800	2.6	64,100	66,300	68,300
	160°F	1.0	70,700	72,500	74,200	1.7	78,000	80,400	82,600	2.5	82,900	85,800	88,400
	180°F	1.0	86,900	89,200	91,300	1.6	95,900	98,900	101,600	2.4	101,800	105,300	108,600

## Unit Size 20

Water Coil Size	Entering Water Temp	3 GPM				4 GPM				5 GPM			
		H <sub>2</sub> O P.D. (in FT)	CFM			H <sub>2</sub> O P.D. (in FT)	CFM			H <sub>2</sub> O P.D. (in FT)	CFM		
			1800	1900	2000		1800	1900	2000		1800	1900	2000
3 ROW	120°F	1.1	43,700	44,400	45,100	1.9	49,100	50,100	51,100	2.9	52,900	54,100	55,300
	140°F	1.1	61,700	62,700	63,700	1.9	69,300	70,800	72,100	2.8	74,600	76,400	78,000
	160°F	1.1	79,900	81,200	82,500	1.8	89,700	91,600	93,300	2.8	96,500	98,800	100,900
	180°F	1.1	98,200	99,900	101,400	1.8	110,300	112,600	114,700	2.7	118,600	121,400	124,000

All capacities are based on 70°F entering air temperature.

For entering air temperatures other than 70°F use the following capacity correction factors: (72°F x .982), (68°F x 1.02), (66°F x 1.04).

Glycol correction factors: (10% X .98), (20% X .95), (30% X .92), (40% X .88)

# Sample Hydronic System Design

Includes: Heating coil selection, line sizing and selected pump other than supplied by ADP

## Sample Application

3 ton Cooling Load  
 180° F Water Temp  
 40% Glycol Mixture  
 80,000 BTUH Heat Required

(1) From the Heating Capacity Tables select the Air Handler that supplies at least 80,000 BTUH at 1,200 CFM, 180° F water temperature.

The Unit Size 12 hot water coil supplies 94,000 BTUH @ 5 GPM, 6.3' pressure drop  
 Correct capacity for 40% glycol (correction factors found below capacity chart)

	94,000
Corrected coil heating capacity (BTUH)	X 0.88
	= 82,720

(2) Determine total equivalent line length

Note: Use the following line sizes as a guide for initial selection

1 - 3 GPM, 3/4"	4 - 5 GPM, 1"	6 - 8 GPM, 1 1/4"
-----------------	---------------	-------------------

Line size	1"			Equiv. ft. of pipe (Table 3)		
Total number of fittings	Quantity		X		=	
90° SR elbows	20			2.7'	=	54'
90° LR elbows	0			0	=	0
45° elbows	0			0	=	0
gate valves	2			1.9'	=	3.8'
Total supply and return line length					+	186'
<b>Total equivalent line length</b>					=	<b>244'</b>

(3) Determine total pump head required

		Press. Drop/ft (Table 1)		
Total equivalent line length	244'	X 0.023	=	5.61
Total pressure drop through coil (found on capacity chart)			+	6.3'
Line length correction factor for 40% glycol @ 180°F (Table 2)			X	1.12
<b>Total pump head required</b>				<b>13.34'</b>

(4) Now select a pump that supplies 5 GPM with at least 13.34' head capability.

Note: If desired, recalculation can be done with another line size to vary pump requirement.

Nominal Pipe Size	GPM																	
	1	1.25	1.5	1.75	2	2.25	2.5	2.75	3	3.25	3.5	3.75	4	4.5	5	6	7	8
1/2"	.030	.048	.065	.083	.100	.125	.150	.175	.200	-	-	-	-	-	-	-	-	-
3/4"	.005	.009	.012	.016	.019	.024	.029	.034	.039	.045	.050	.056	.062	.077	.092	.130	-	-
1"	-	-	-	-	.005	.006	.007	.008	.009	.011	.012	.014	.015	.019	.023	.033	.042	.053
1 1/4"	-	-	-	-	-	-	-	-	-	-	-	-	.005	.007	.008	.011	.015	.018

% Glycol	140°F	160°F	180°F
10	1.04	1.04	1.02
20	1.08	1.07	1.04
30	1.13	1.11	1.08
40	1.19	1.16	1.12
50	1.24	1.21	1.17

Pipe Size	90° SR el	90° LR el	45° el	gate valve
1/2"	1.5	0.8	1	1
3/4"	2	1	1.4	1.4
1"	2.7	1.3	1.9	1.9
1 1/4"	3.6	1.8	2.5	2.5

# Maximum Line Lengths for Heating Coils

Using factory installed circulator

All line lengths are total for supply and return

Model Size	Nominal Pipe Size (ID)	Maximum Supply Pipe Length (ft.) type K copper																		
		GPM																		
		1	1.3	1.5	1.8	2	2.3	2.5	2.8	3	3.3	3.5	3.8	4	4.3	4.5	4.8	5	6	7
8	1/2"	256	148	98	70	51	33	20	12	5	-	-	-	-	-	-	-	-	-	-
	3/4"	-	-	-	454	351	251	186	140	105	-	-	-	-	-	-	-	-	-	-
12	3/4"	-	-	-	-	-	-	-	-	126	97	75	57	43	30	19	11	4	-	-
	1"	-	-	-	-	-	-	-	-	-	497	397	319	257	200	156	120	90	-	-
	1 1/4"	-	-	-	-	-	-	-	-	-	-	-	-	-	-	514	405	315	-	-
16	3/4"	-	-	-	-	-	-	-	-	126	97	75	57	43	30	19	11	4	-	-
	1"	-	-	-	-	-	-	-	-	-	497	397	319	257	200	156	120	90	-	-
	1 1/4"	-	-	-	-	-	-	-	-	-	-	-	-	-	-	514	405	315	-	-
20	3/4"	-	-	-	-	-	-	-	-	123	94	72	54	40	27	16	8	-	-	-
	1"	-	-	-	-	-	-	-	-	-	485	382	306	244	187	143	106	77	-	-
	1 1/4"	-	-	-	-	-	-	-	-	-	-	-	-	-	-	476	367	278	-	-

**Notes:**

- Line lengths are based on water only. To adjust maximum line lengths for glycol, divide length by the factors shown in **Table 2**.
- IMPORTANT:** Glycol should never be used in a potable water system.
- All lengths are based on closed loop systems.
- Line lengths within the shaded areas should not be used when a water heater is the source of heat. For these line lengths, excessive line temperature loss will occur and must be accounted for.
- Supply and return lines must be properly insulated to reduce temperature loss and to prevent freezing when passing through an unconditioned space.
- All lengths include (12) 90° short radius elbows. To adjust for extra or fewer fittings, use the factors in **Table 1**.
- Always use full flow ball or gate valves to minimize pressure drop.


**Table 1**

Pipe size	Equivalent ft. of pipe			
	90° SR el	90° LR el	45° el	gate valve
1/2"	1.5	0.8	1	1
3/4"	2	1	1.4	1.4
1"	2.7	1.3	1.9	1.9
1 1/4"	3.6	1.8	2.5	2.5

**Table 2**

% Glycol	Fluid Temperature		
	140° F	160° F	180° F
10	1.04	1.04	1.02
20	1.08	1.07	1.04
30	1.13	1.11	1.08
40	1.19	1.16	1.12
50	1.24	1.21	1.17

# Dimensions

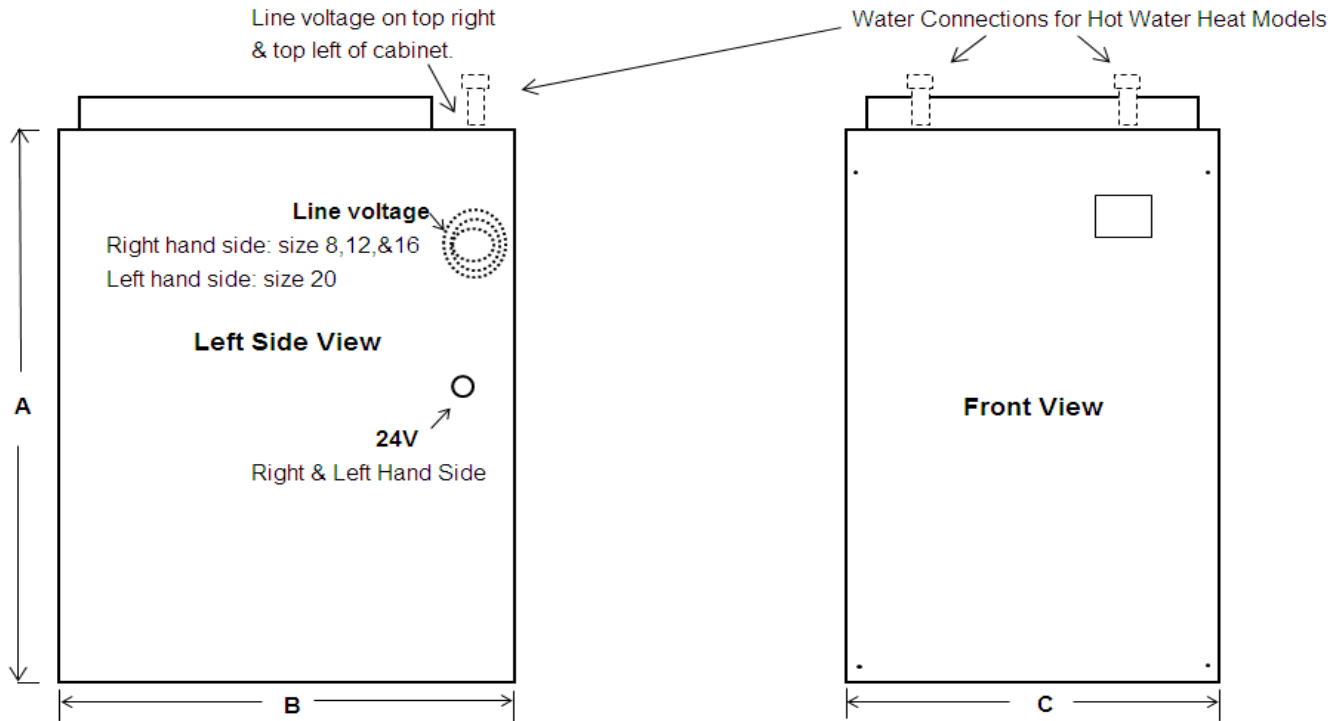

Unit Size	A (in)	B (in)	C (in)	Supply Duct Opening		Return Duct Opening	
				Depth (in)	Width (in)	Depth (in)	Width (in)
<b>8 &amp; 12</b>	27	20 1/2	17 1/2	16	15 1/2	19 1/4	16
<b>16</b>	28	20 1/2	21	16	19	19 1/4	19 1/2
<b>20</b>	28	20 1/2	24 1/2	16	22 1/2	19 1/4	23